


SITUATION 1*:

Building automation system
(potential free output)




SITUATION 2*:

Building automation system
(230Vac output)

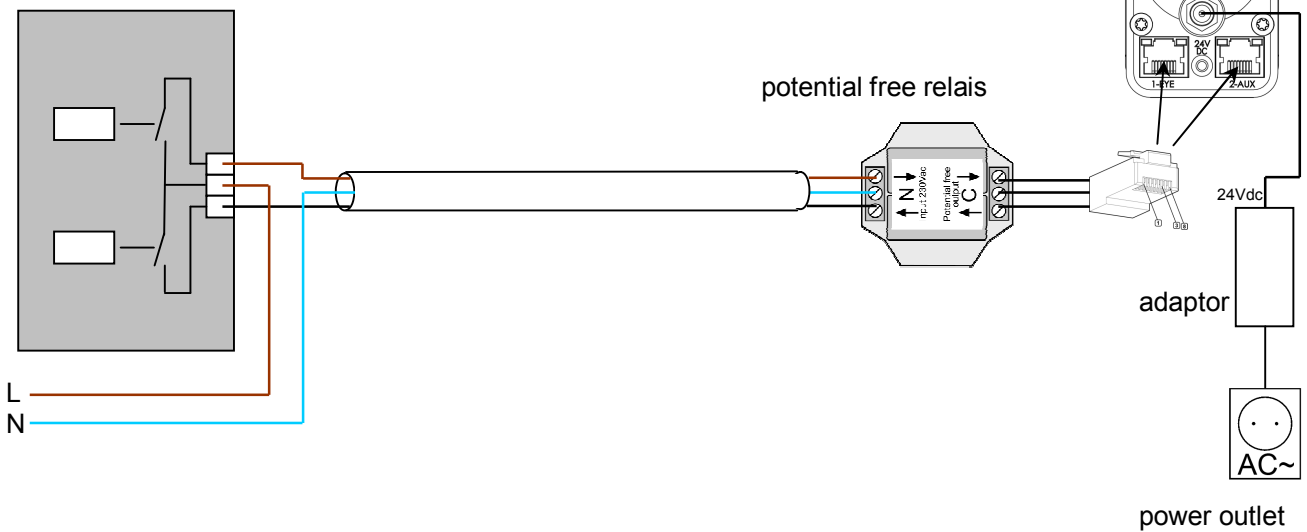

SITUATION 3*:

Building automation system
(230Vac output)

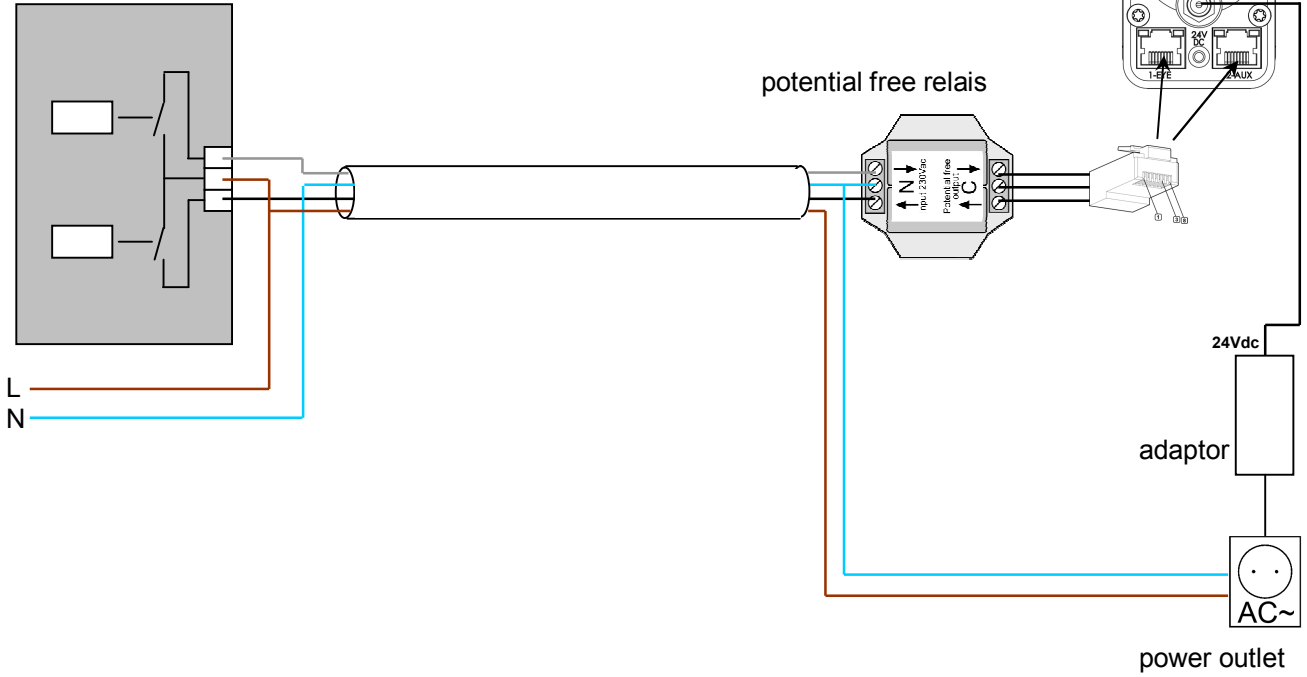

* The motor must be installed by an installer who is qualified in motorized systems. Installation must be done according to local regulations.